

Wavin UK (Holdings) Ltd

Crow Edge
Hazlehead
Sheffield
South Yorkshire S36 4HG
Tel: 01709 856300 Fax: 01709 856301
e-mail: info@wavin.co.uk
website: www.intesio.co.uk



Agrément Certificate
03/4018
Product Sheet 4

INTESIO ATTENUATION AND INFILTRATION SYSTEMS


AQUACELL ECO ATTENUATION AND INFILTRATION SYSTEM

PRODUCT SCOPE AND SUMMARY OF CERTIFICATE

This Certificate relates to the AquaCell Eco Attenuation and Infiltration System, which can be used either for sub-surface water storage or as a soakaway to manage run-off from impermeable surfaces.

AGRÉMENT CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.

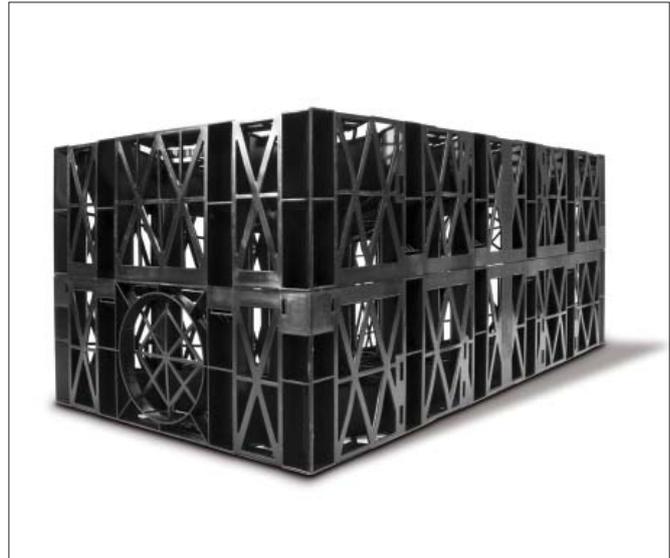

KEY FACTORS ASSESSED

System design — data is provided in the Certificate to assist in the design of a stormwater management system (see section 6).

Structural performance — the system has adequate strength and stiffness to resist long- and short-term loads when used in accordance with this Certificate (see section 7).

Durability — the system will have a service life in excess of 50 years when installed in accordance with this Certificate (see section 12).

The BBA has awarded this Agrément Certificate to the company named above for the system described herein. This system has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of First issue: 15 June 2012

Brian Chamberlain
Head of Approvals — Engineering

Greg Cooper
Chief Executive

The BBA is a UKAS accredited certification body — Number 113. The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk

Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct.

British Board of Agrément
Bucknalls Lane
Garston, Watford
Herts WD25 9BA

©2012

tel: 01923 665300
fax: 01923 665301
e-mail: mail@bba.star.co.uk
website: www.bbacerts.co.uk

Regulations

In the opinion of the BBA, the AquaCell Eco Attenuation and Infiltration System, if used in accordance with the provisions of this Certificate, will meet or contribute to meeting the relevant requirements of the following Building Regulations (the presence of a UK map indicates that the subject is related to the Building Regulations in the region or regions of the UK depicted):



The Building Regulations 2010 (England and Wales)

Requirement: H3(3)	Rainwater drainage
Comment:	The units can be used in a construction to meet this Requirement. See sections 6.1 to 6.10 of this Certificate.
Requirement: Regulation 7	Materials and workmanship
Comment:	The system is acceptable. See section 12 and the <i>Installation</i> part of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation: 8(1)(2)	Fitness and durability of materials and workmanship
Comment:	The use of the system satisfies the requirements of this Regulation. See sections 11.1 to 11.6, 12 and the <i>Installation</i> part of this Certificate.
Regulation: 9	Building standards — construction
Standard: 3.6	Surface water drainage
Comment:	The units can be used in a construction to satisfy this Standard, with reference to clauses 3.6.1 ⁽¹⁾⁽²⁾ to 3.6.5 ⁽¹⁾⁽²⁾ . See sections 6.1 to 6.10 of this Certificate.
Standard: 7.1(a)(b)	Statement of sustainability
Comment:	The system can contribute to meeting the relevant Requirements of Regulation 9, Standards 1 to 6 and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard. (1) Technical Handbook (Domestic). (2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2000 (as amended)

Regulation: B2	Fitness of materials and workmanship
Comment:	The system is acceptable. See section 12 and the <i>Installation</i> part of this Certificate.
Regulation: B3(2)	Suitability of certain materials
Comment:	The system is acceptable. See sections 11.1 to 11.6 of this Certificate.
Regulation: N5	Rain-water drainage
Comment:	The system can be used in a construction to satisfy this Regulation. See sections 6.1 to 6.10 of this Certificate.

Construction (Design and Management) Regulations 2007

Construction (Design and Management) Regulations (Northern Ireland) 2007

Information in this Certificate may assist the client, CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

See sections: 3 *Delivery and site handling* (3.3) and 15 *Installation — Procedure* part of this Certificate.

Additional Information

NHBC Standards 2011

In the opinion of the BBA, the use of the AquaCell Eco Attenuation and Infiltration System in relation to this Certificate is not subject to the requirements of these Standards.

Technical Specification

1 Description

1.1 The AquaCell Eco Attenuation and Infiltration System consists of individual, black recycled polypropylene modular units (see Table 1), black polypropylene shear connectors and black polypropylene clips (see Figure 1). The system assembles to form an underground structure which can be used either for sub-surface water storage or as a soakaway to manage run-off from impermeable surfaces.

Table 1 Characteristics of modular unit


Element (Unit)	Value
Dimensions (nominal) (l x w x h) (mm)	1000 x 500 x 400
Volume (nominal) (m ³)	0.20
Storage volume (nominal) (m ³)	0.19
Porosity (void ratio) (%)	95
Ultimate compressive strength at yield (kN·m ⁻²)	
– vertical loading on top face	175
– lateral loading on side face	40
Short-term deflection (mm per kN·m ⁻²) ⁽¹⁾	
– vertical loading on top face	1 per 21
– lateral loading on side face	1 per 6
Estimated long-term deflection ⁽²⁾ (Ln) ⁽³⁾ (mm)	0.1069

(1) Applied load.

(2) At up to 20 years at 20°C at 52 kN·m⁻² load.

(3) Time in hours.

Figure 1 Components

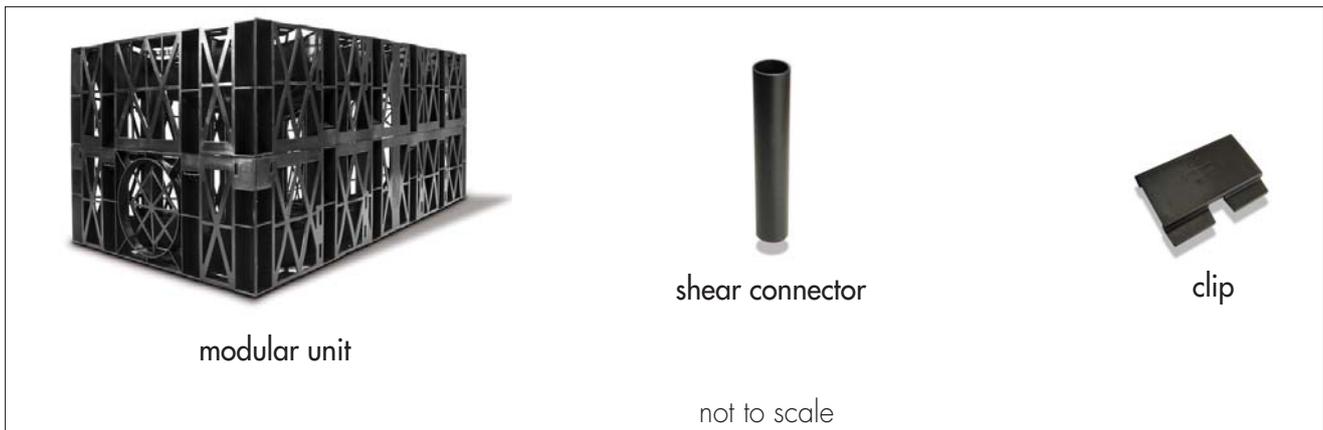

1.2 The system manages stormwater run-off from impermeable surfaces by:

- infiltration, ie as a soakaway to infiltrate water back into the ground
- attenuation, ie as temporary storage for excess flows and to control outflow to streams and rivers
- a combination of the above methods.

1.3 The polypropylene modular units have pre-formed sockets to enable connection with 160 mm diameter pipework. Alternatively, connection to 150 mm pipework is possible using an adaptor. Connection can also be made, at points other than the pre-formed sockets, to suitable 150 mm pipework using a flange adaptor. Adaptors and connecting pipework for use with this system are outside the scope of this Certificate.

1.4 Each assembly is wrapped in either a permeable geotextile when used for infiltration or an impermeable geomembrane when used for attenuation. Geotextiles and geomembranes for use with the system are outside the scope of this Certificate. Information on their required specification may be obtained from the Certificate holder.

1.5 Adequate venting must be provided to the structure using an air vent. One 110 mm diameter air vent is required per 7500 m² of impermeable catchment area to be drained. Air vent connections and pipework for use with this system are outside the scope of this Certificate.

2 Manufacture

2.1 The components are injection moulded from polypropylene.

2.2 To ensure product quality is consistently maintained to the required specification, the BBA has:

- agreed with the Certificate holder/manufacturer the quality control procedures and product testing to be undertaken
- assessed and agreed the quality control operated over batches of incoming materials
- monitored the production process and verified that it is in accordance with the documented process
- evaluated the process for management of nonconformities
- checked that equipment has been properly tested and calibrated
- undertaken to carry out the above measures on a regular basis as part of a surveillance process to ensure that standards are maintained and that the product or system remains as Certificated.

3 Delivery and site handling

3.1 The system is supplied to site in packs of 12 or 15 units, secured with straps with plastic feet attached to the underside to enable placing and movement by a fork-lift. Each pack of units carries a label bearing the AquaCell type, part number, operator's initials and date of manufacture.

3.2 Each unit is supplied with two shear connectors and three clips.

3.3 The packs of the units should be carefully placed on level ground and should not be stacked on site. Loose individual modules should not be stored more than two units high.

3.4 The units can resist the effects of ultraviolet light for up to six months. However, prolonged exposure to direct sunlight should be avoided.

3.5 Units should not be stored near fuel bowsers, fuel tanks or areas where solvents may be kept.

3.6 The units are resistant to damage that could occur with normal handling. They should be stored away from the possibility of impacts by vehicles and other construction plant.

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on the Aquacell Eco Attenuation and Infiltration System.

Design Considerations

4 General

4.1 The AquaCell Eco Attenuation and Infiltration System design must be in accordance with the Certificate holder's *Stormwater Solutions — Design Manual*. Guidance on the application of sustainable drainage systems (SUDS) for new developments, such as the AquaCell Eco Attenuation and Infiltration System, can also be found in the Communities and Local Government Planning Policy Statement PPS25 *Development and Flood Risk* and *The SUDS Manual C697* published by the Construction Industry Research and Information Association (CIRIA).

4.2 The system can be used for the control of stormwater run-off from impermeable surfaces in three main ways:


- infiltration — water is collected in the units during rainfall and allowed to drain away by soaking into the surrounding ground over a period of time
- attenuation — water is collected in the units during rainfall and released at a reduced flow rate through a flow control device into an appropriate outfall. This reduces peak flows in the watercourse, thereby minimising the risk of flooding
- combined — a combination of the above two systems.

4.3 Design of the appropriate system (see Figure 2 and Table 2) for a specific project must always be preceded by a detailed audit of the proposed site to establish:

- existing factors and considerations applicable to the site
- predicted factors relating to the site's use following the planned development, and the parameters within which the installation is required to function
- the type of function of application suggested by this audit.

4.4 Once the project criteria have been established from the site audit, there are two main parts to the design procedure: hydraulic design and structural design.

Figure 2 AquaCell unit selection flowchart⁽¹⁾⁽²⁾

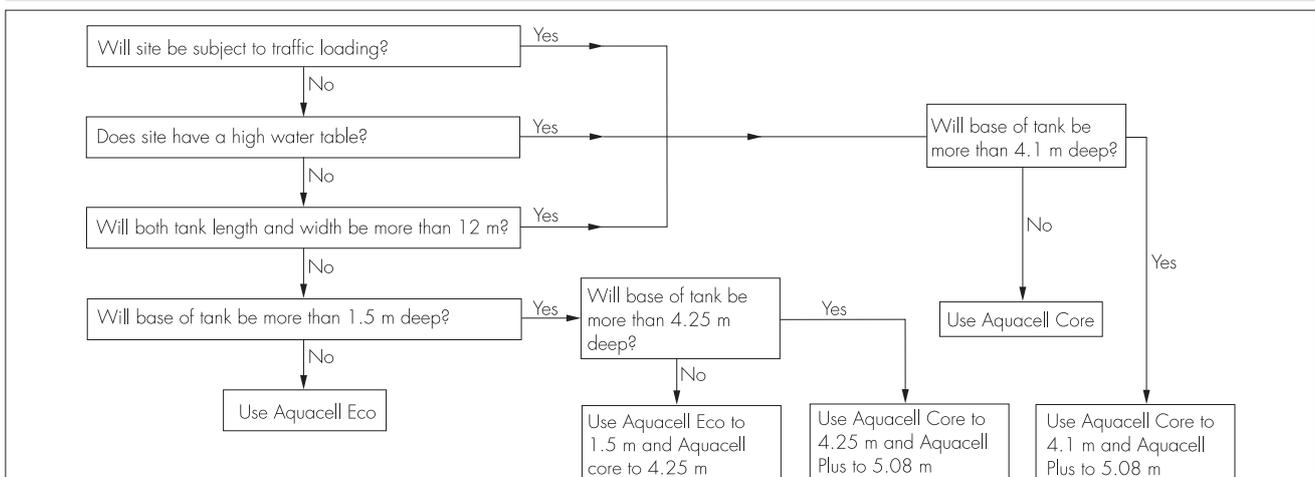

(1) This Certificate covers Aquacell Eco units only — the validity of Certificates covering other Aquacell units can be checked on the BBA website: www.bbacerts.co.uk.

(2) Maximum burial depths assume ideal soil conditions and should be verified by site investigations (see section 6 of this Certificate for information relating to structural design). Maximum burial depths for a variety of soil types are given in Table 7.

Table 2 Design information checklist

Description	Information source
A Existing factors	
Topography	Site survey or inspection
Area of catchment ⁽¹⁾	Site survey
Hydrology of catchment	Site inspection and observations
Soil type ⁽¹⁾	Site investigation
Structural properties of soil — CBR, stiffness	Site investigation and laboratory testing
Infiltration potential of soil	Site investigation
Contamination ⁽¹⁾	Site investigation and desk research
Details of receiving water, watercourse/aquifer	Environment Agency, Scottish Environment Protection Agency or water sewerage company
Environmental sensitivity of site	Environment Agency, Scottish Environment Protection Agency or water sewerage company
Groundwater vulnerability and source protection status	Environment Agency, Scottish Environment Protection Agency or water sewerage company
B Predicted factors	
Development type and land use	Proposed development plans
Traffic loads	Proposed development plans
Rainfall data ⁽¹⁾	Meteorological Office or Wallingford procedure
Discharge design criteria	
– quantity	Environment Agency, Scottish Environment Protection Agency or water sewerage company
– quality	Environment Agency, Scottish Environment Protection Agency or water sewerage company
Health and safety	All affected parties
C Planned function	
Infiltration	Conclusions from A and B audit/review
Attenuation	Conclusions from A and B audit/review

(1) For individual house soakaways, only items referenced for this footnote are required.

5 Practicability of installation

The system is designed to be installed by a competent general builder or contractor with experience of this type of system.

6 System design

Infiltration

Calculation principles

6.1 There are two approaches, either of which may be adopted, ie the Construction Industry Research and Information Association (CIRIA) Report 156 *Infiltration Drainage — Manual of Good Practice* or BRE Digest 365 *Soakaway Design*.

6.2 A simplified approximate approach can be used on a very small site (ie a single-house development) where detailed site infiltration rate information may not be required nor available (see Table 3). From Approved Document H of the England and Wales Building Regulations, for areas up to 25 m², a storage volume equal to the area to be drained multiplied by 10 mm may be used. Beyond this size, design should be carried out in accordance with BS EN 752 : 2008 or BRE Digest 365. It is suggested in BS EN 752 : 2008 that a storage volume equal to 20 mm multiplied by the area to be drained may be used. In Scotland, guidance for the design of single-house soakaways is given in Mandatory Standard 3.6, clause 3.6.5⁽¹⁾.

(1) Technical Handbook (Domestic).

Table 3 Design parameters for single-house roof soakaway

Number of units	Storage volume (m ³)	Maximum area to be drained (m ²)
1	0.19	19 ⁽¹⁾
2	0.38	25 ⁽¹⁾
3	0.57	28.5 ⁽²⁾
4	0.76	38 ⁽²⁾
5	0.95	47.5 ⁽²⁾
10	1.90	95 ⁽²⁾

(1) In accordance with Approved Document H.

(2) In accordance with BS EN 752 : 2008 clause NA 4.4.8.

6.3 When the BRE or CIRIA approach is used, the design volumes and areas for trench or cuboid type installations can be found in Tables 4 and 5.

Table 4 Volumetric data per linear metre for a one-unit (0.5 m) wide trench configuration

Number of units high	Volume (m ³)	Side area (m ²)	Base area (m ²)
1	0.19	0.8	0.5
2	0.38	1.6	0.5
3	0.57	2.4	0.5

Table 5 Volumetric data for 3D usage two units high

No. of units long (1 m side)	2 wide (0.5 m side)			4 wide (0.5 m side)			8 wide (0.5 m side)		
	Vol (m ³)	Side (m ²)	Base (m ²)	Vol (m ³)	Side (m ²)	Base (m ²)	Vol (m ³)	Side (m ²)	Base (m ²)
1	0.76	3.20	1.00	1.52	4.80	2.00	3.04	8.00	4.00
2	1.52	4.80	2.00	3.04	6.40	4.00	6.08	9.60	8.00
4	3.04	8.00	4.00	6.08	9.60	8.00	12.16	12.80	16.00
8	6.08	14.40	8.00	12.16	16.00	16.00	24.32	19.20	32.00
10	7.60	17.60	10.00	15.20	19.20	20.00	30.40	22.40	40.00
100	76.00	161.60	100.00	152.00	163.20	200.00	304.00	166.40	400.00

6.4 For calculations, the size and volume of the units are given in Table 1. The total areas of the base and sides are required as water is absorbed through the geotextile soil interface. Storage volume is 95% of the total volume. As an example, using Table 4, for a typical linear trench 40 m long and two units deep, the volume is 0.38 by 40 = 15.2 m³, the side area is 1.6 by 40 = 64 m² and the base area is 0.5 by 40 = 20 m².

Attenuation

Calculation principles

6.5 The anticipated run-off volume (A) from the site must be estimated. The most commonly used method for evaluating storm rainfall events in the UK is the Wallingford Procedure by which the total rainfall level of storms over defined time periods ranging from five minutes up to 48 hours is assessed. The depth of water (mm) found can be multiplied by the catchment area to assess the size of attenuation systems and is normally based upon a two-hour storm of a return period appropriate for the catchment. The allowable discharge rate from the site to an appropriate outfall is established but will normally be set by the Environment Agency or Planning Authorities. The outflow volume (B) to be discharged at this rate over the two-hour period is calculated and subtracted from the run-off volume (A – B). This defines the excess volume (C) to be stored in AquaCell Eco units constructed as an underground tank. The number of AquaCell Eco units needed to contain this excess is calculated on the basis that the storage volume is equal to 95% of the total volume of the tank.

Connection

6.6 Connection is made to AquaCell Eco units using a pre-formed socket.

Manifold design

6.7 The capacity of this input pipe is limited and may be insufficient for the anticipated flow load. Therefore, the flow load may be split between a number of 150 mm diameter flow pipes or other connection arrangements used (see Figure 3). The maximum areas that can be drained according to the number of input pipes provided, is given in Table 6. The calculations are based on:

- paved surfaces — two year, three to five minute event
- eaves drained roofs — one year, two minute event
- internal gutters — 500 year, two minute event.

Figure 3 Typical inlet connection designs

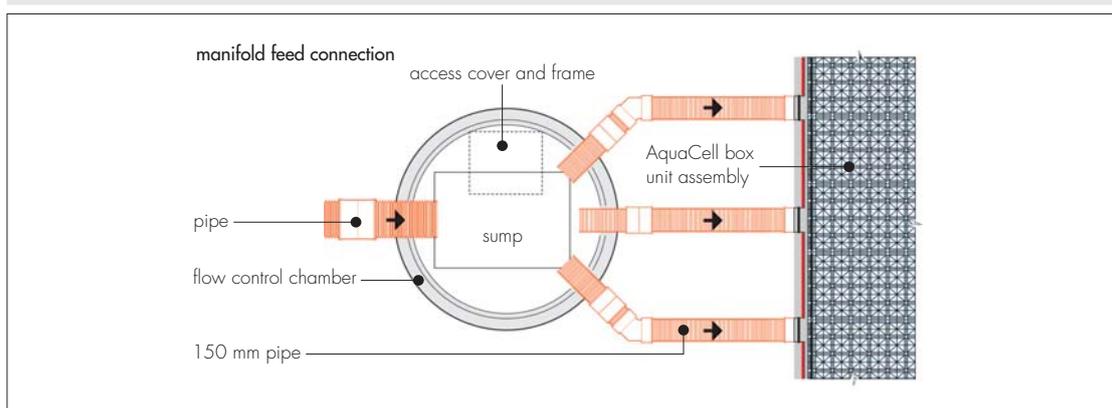


Table 6 Multiple manifolds

Surface type	Drainage are (m ²) Number of inlet pipes					
	1	2	3	4	5	6
Paved area	1110	2220	3330	4440	5550	6660
Roof area ⁽¹⁾	841	4682	2523	3364	4205	5046
Roof area ⁽²⁾	210	420	630	840	1050	1260

(1) Roofs drained by eaves gutters, close to the attenuation site (within 25 m).

(2) Roofs drained by internal gutters, close to the attenuation site (within 25 m) (especially siphonic roof drainage).

Flow control

6.8 The outflow from the tank must be controlled to comply with the discharge rate consent of the site. There are four main methods to achieve outflow control, ie orifice plate, Garastor, vortex control or small pipe. Comparative features and benefits of these various flow control devices should be considered prior to selection. These devices are outside the scope of this Certificate.

Outflow positioning and head calculations

6.9 The invert level of the outflow pipe should be flush with, or lower than, the bottom of the lowest unit to allow the tank to drain. As the tank fills, a depth of water develops on the upstream side of the outflow control. For a tank with two layers of AquaCell Eco units, this depth is 0.8 m when the units are full, creating a driving head to push the flow through the control device. For design purposes, the head used in calculations is taken as that at the centre line of the outflow device.

7 Structural performance

7.1 AquaCell Eco units can be placed under a wide variety of landscaped or pedestrian areas. Design procedures for trafficked applications are outside the scope of this Certificate. If the proposed application of the Aquacell Eco is in areas subject to traffic or other heavy loads, the advice of the Certificate holder should be sought.

7.2 The short-term ultimate compressive strength at yield for the AquaCell Eco units, as derived from independent test data, is 175 kN·m⁻² for vertical loading on the top face and 40 kN·m⁻² for lateral loading on the side face. A partial factor of safety for materials (f_m) of 2.75 for ultimate limit state and 1.5 for serviceability limit state should be applied to these values for a design life of 20 years. The short- and long-term deflections are given in Table 1.

7.3 Creep tests indicate that the long-term deflection may be estimated from the following expression. This is valid for loads up to 52 kN·m⁻² for durations of up to 10 years at 20°C. In locations where settlement is not a concern, designs of up to 50 years can be considered:

- deflection (mm) = 0.1069 Ln (time in hours) + 1.2561.

7.4 For small-scale applications such as soakaways for individual house roof drainage, the AquaCell Eco system is typically located below a garden a minimum of 5 m from the building.

7.5 AquaCell Eco units used for large-scale storage or infiltration must be designed to carry all loads that will be applied, including dead and imposed loads. Design parameters and estimated loads should be used to determine the maximum depth of installation and the maximum and minimum cover depths.

7.6 The criteria provided in Tables 7 and 8 can be used to design the AquaCell Eco units for installation below non-trafficked areas. These design tables are only applicable in temperate climate conditions such as those in the UK. The partial safety factors for loads that have been applied are given in Table 8. Partial factors of safety for materials (f_m) of 2.75 for ultimate limit state and 1.5 for serviceability limit state have been applied.

Table 7 Maximum installation depths (to base of units) and minimum cover depths⁽¹⁾

Soil type	Typical shear angle (°)	Maximum installation depth (m)	Minimum cover depth (m)
Stiff over-consolidated clay (eg London clay)	24	0.95	0.30
Normally consolidated silty, sandy clay (eg alluvium, made ground)	26	1.05	0.30
Loose sand and gravel	29	1.2	0.30
Medium dense sand and gravel	33	1.5	0.30
Dense sand and gravel	38	1.9	0.30

(1) These values relate to installations where the groundwater is a minimum of one metre below the base of the excavation. Aquacell Eco units should not be used where groundwater is present.

Table 8 Partial safety factors for loads used for design

Description	Symbol	Ultimate limit state	Serviceability limit state
Vertical dead load	f_{dl}	1.40	1.00
Earth pressure (horizontal) dead load	f_{ep}	1.40	1.00
Imposed live load	f_{ll}	1.60	1.00

7.7 For lightly-loaded applications, the bearing capacity of the underlying soils, typically, should not be exceeded by the AquaCell Eco System. Therefore, settlement of the underlying soils should be negligible. On weak or compressible soils, the bearing capacity and settlement characteristics should be confirmed by a geotechnical engineer.

7.8 Care should be taken when the AquaCell Eco system is used for infiltration close to trafficked areas and structures. It is important to ensure that the infiltrating water will not soften the soils or cause loss of fines and settlement.

8 Geotextiles and geomembranes

8.1 In infiltration applications, the geotextile wrapped around the AquaCell Eco system prevents soil entering the units and stops the soil which surrounds the unit becoming clogged with silt present in run-off. In attenuation/storage applications, the geotextile serves to protect the geomembrane.

8.2 The selection of an appropriate geotextile for a specific AquaCell Eco infiltration installation should be considered carefully, with particular reference to the surrounding soil properties and required performance. Points to consider are:

- the pore size should be designed and specified to assist infiltration and prevent migration of fine soil particles
- the permeability and breakthrough head should not limit the flow of water in the system, and should be similar to or greater than the surrounding materials
- the material must be able to resist the punching stresses caused by loading on sharp points of contact
- its strength should be sufficient to resist the imposed forces (eg from traffic).

8.3 The geotextile should be selected according to specific site conditions. However, typically, a 300 g non-woven material will be suitable for most situations. Specialist advice should be sought if surrounding soil characteristics exhibit a high degree of fines/low infiltration capacity and/or there is risk of damage from ground contaminants.

8.4 In attenuation/storage applications where infiltration is not possible or permitted, an impermeable geomembrane is wrapped around the AquaCell Eco system to prevent release of attenuated/stored water into surrounding ground and to prevent inflow of pollutants from contaminated subsoil into the storage reservoir.

8.5 The specification and selection of the impermeable geomembrane must be correct for the installation envisaged, to ensure it performs to the level required. It is essential that the specified material:

- withstands the rigours of installation
- resists puncture
- resists multi-axial elongation stress and strains associated with settlement
- resists environmental stress cracking
- resists damage from ground contaminants
- remains intact for the full design life.

8.6 Geomembranes less than 1 mm thick are unlikely to meet these criteria⁽¹⁾, and are not recommended for use with the AquaCell Eco system⁽²⁾. A specification for a typical polypropylene geomembrane is shown in Table 9.

(1) Except in shallow, domestic installations.

(2) Further details can be obtained from the Certificate holder.

Table 9 Typical specification for a polypropylene geomembrane

Property	Value	Test method
Thickness ± (mm)	1.0	ASTM D 751
Density (minimum) (g·cm ⁻³)	0.9	ASTM D 792
Tensile stress at break (min) (N·mm ⁻²)	18	ASTM D 638
Elongation break (%)	>700	ASTM D 638
Puncture resistance (min) (N)	150	FTMS 101C, Method 2065
Tear resistance (min) (N)	60	ASTM D 1004
Dimensional stability (max) (% change)	±2.0	ASTM D 1204, 1 h at 100°C
Stress crack resistance (%)	100	ASTM D 5397
Volatile loss, 5% loss (max)	0.2	ASTM D 1203
Ozone resistance	No cracks	ASTM D 1149
Carbon black content (%)	2 to 3	ASTM D 1603
Moisture vapour (g·m ⁻² ·day ⁻¹)	<0.1	ASTM E 96
Friction angle (non-woven geotextile)	21°	Shear box
Methane permeability (g·m ⁻² ·day ⁻¹ ·atm ⁻¹)	0.11	European Standard
Methane transmission rate (m ³ ·m ⁻² ·s ⁻¹ ·atm ⁻¹)	0.8 × 10 ⁻⁹	BRE
Permeability coefficient	1.8 × 10 ⁻¹²	
Application temperature (°C)	>4	


8.7 To ensure total impermeability, joints between adjacent sheets of impermeable geomembranes should be sealed correctly using proprietary welding techniques. The integrity of joints should be demonstrated by non-destructive testing⁽¹⁾.

(1) Advice on seam testing is given in CIRIA SP124 Barriers, liners and cover systems for containment and control of land contamination.

9 Venting

9.1 Adequate venting must be provided to the AquaCell Eco structure. One 110 mm diameter air vent is required per 7500 m² of impermeable catchment area to be drained (see Figure 4).

Figure 4 Typical air vent system

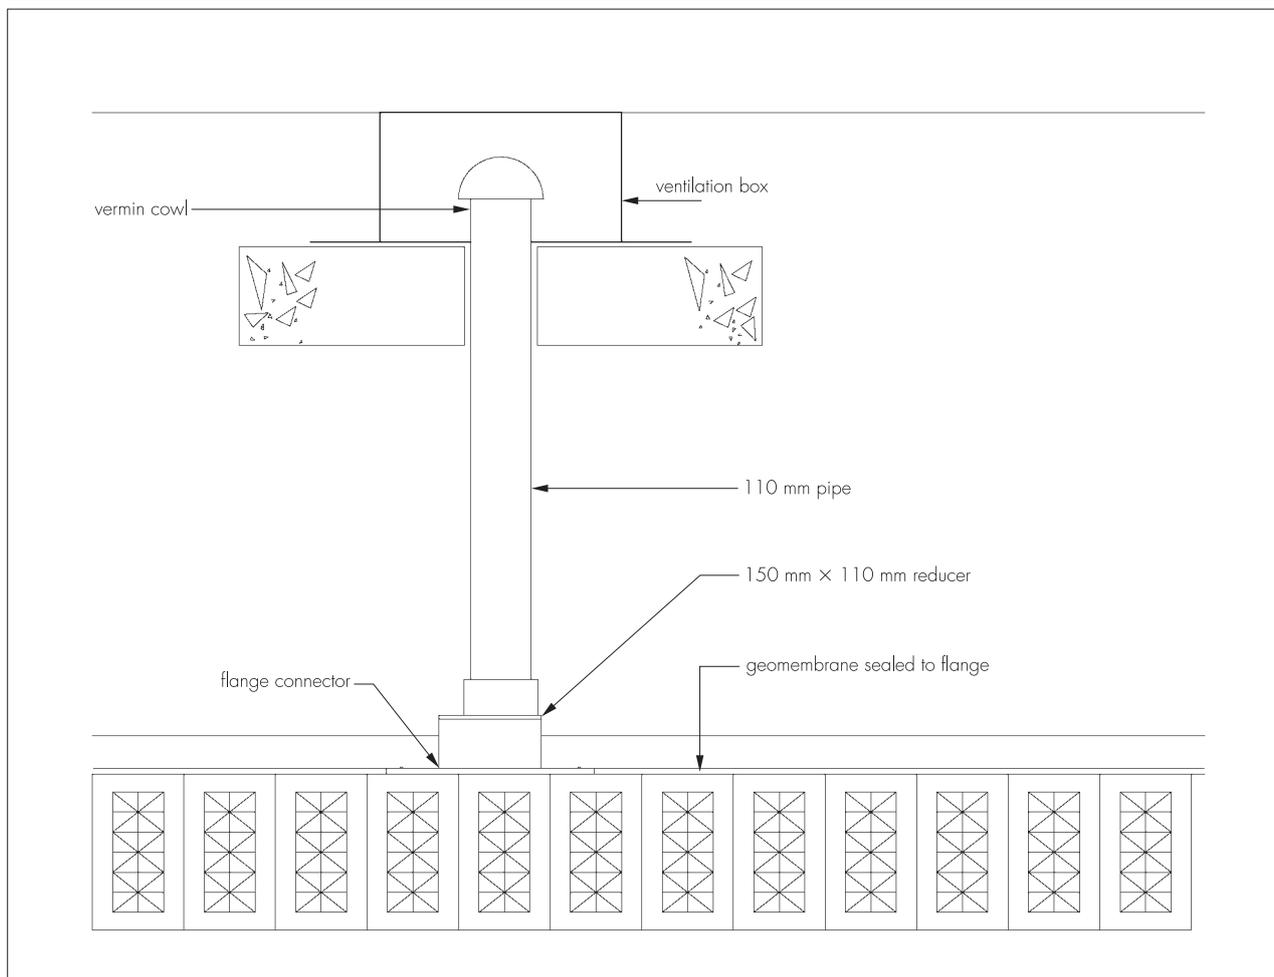

9.2 Typical air vent connectors and pipework can be seen in the Certificate holder's *Stormwater Solutions – Design Manual*. It is recommended that all air vent installations in attenuation/storage applications (using an impermeable geomembrane) are made using a flange adaptor. Adhesive or double-sided tape should be used between the geomembrane and flange adaptor to ensure a watertight seal.

10 Resistance to chemicals

10.1 An assessment by the BBA indicates that the components of the system are suitable for use in contact with the chemicals likely to be found in rainwater.

10.2 An assessment of the suitability for use of AquaCell Eco units on brownfield sites should be made only after a suitable site investigation to determine the possibility for chemical attack. Particular care must be taken where acids and organic solvents are present at high concentrations. Further information can be obtained from the Certificate holder.

11 Maintenance


11.1 The customer is responsible for maintenance. Recommendations for maintenance of SUDS systems are given in CIRIA C697.

11.2 For soakaways to individual houses, the only necessary maintenance is to keep gullies clear of debris such as leaves.

11.3 For large installations or where the receiving waters are environmentally sensitive, a system of regular inspections should be established to prevent the accumulation of silt in the system which, if allowed to develop, would reduce effectiveness. They should also be inspected after every major storm event.

11.4 It is recommended that a silt trap is incorporated into the pipework at the inlet to the tank (see Figure 5). There must be a maintenance plan that ensures regular cleaning of the trap to ensure correct performance. Silt traps for use with this system are outside the scope of this Certificate.

Figure 5 Typical silt trap

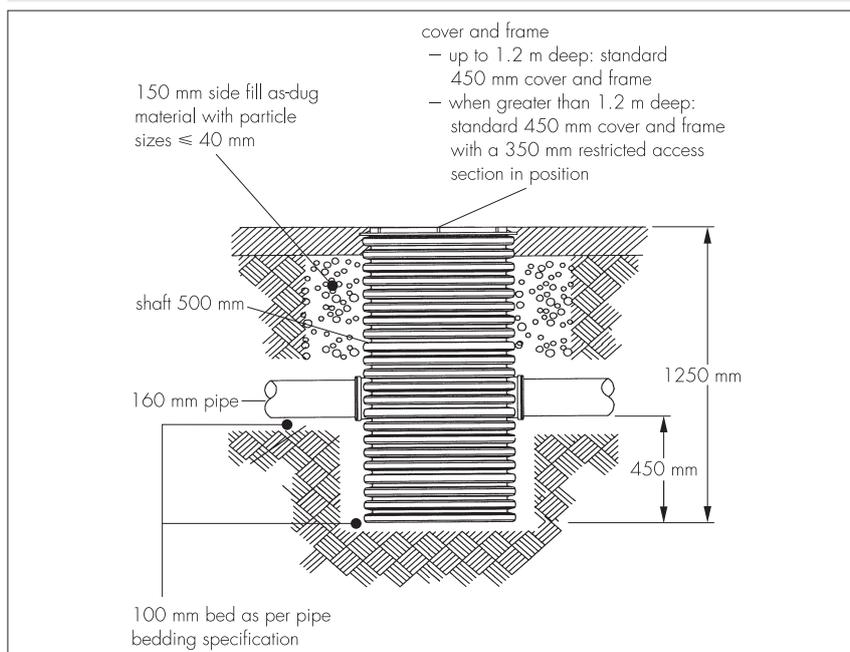

11.5 For all flow control devices it is sensible to incorporate access (via a manhole or similar) to the location of the pipe entry, orifice or vortex control. This will enable easy removal of any blockage. The orifice itself may be protected by a debris screen.

11.6 Paved surface areas above an installation should be inspected at the same time to ensure the units continue to provide the required structural support.

12 Durability

The structural properties of polypropylene used in the components of the system will deteriorate with time and should be taken into account at the design stage by the application of suitable safety factors. In the opinion of the BBA, the AquaCell Eco Attenuation and Infiltration System, when used in accordance with this Certificate, will have a life in excess of 50 years.

13 Re-use and recyclability

The system comprises polypropylene components which can be readily recycled.

14 General

The Aquacell Eco Attenuation and Infiltration System should be installed in accordance with the Certificate holder's *Intesio Stormwater Solutions — Design Manual*.

15 Procedure

15.1 The hole or trench is excavated to the required depth, dimensions and levels. It must be ensured that the plan area is sufficient to allow plant access around sides to compact backfill material (300 mm minimum). The base must be smooth and level without sharp drops or humps. Slopes must be cut to a safe angle or adequately supported and safe access must be provided to allow personnel to enter the excavation.

15.2 The base must be inspected for soft spots in the formation — any present must be excavated and replaced with compacted granular fill material.

15.3 A 100 mm thick, bedding layer of coarse sand is laid on the base and sides of the excavation. If required in attenuation systems, a layer of geotextile is laid to protect the impermeable geomembrane.

15.4 The impermeable geomembrane (or geotextile, if in an infiltration system) is laid over the sand bedding layer and up the sides of the excavation. The impermeable geomembrane is inspected for damage and all welds are tested as required. Joints between adjacent sheets of impermeable membrane should be sealed correctly using proprietary techniques with a minimum lap of 50 mm. Jointing with tape is not recommended as the system then becomes reliant on the mechanical properties of the tape to maintain its integrity.

15.5 The AquaCell Eco units are installed in accordance with the installation schedule for correct orientation. Wherever possible, continuous vertical joints should be avoided. The units are arranged so that pre-formed sockets are in the correct alignment for inlet and outlet pipes. For single-layer applications, Wavin clips are used; and for multilayers, Wavin clips and shear connectors are used.

15.6 The geotextile or impermeable geomembrane encapsulation to base, sides and top of installation, including protective geotextile (if required to protect the geomembrane) is completed. Impermeable geomembranes should be welded with double seams. All welds should be tested as required and the membrane inspected for damage.

15.7 Drainage connections are made to the installation using proprietary adaptors. Preformed socket positions for pipe connections must be located at the correct position for receiving pipework. It is recommended that air vent connections in attenuation/ storage applications are made with a flange adaptor using adhesive or double-sided tape to form a seal. Drainage connections are sealed into preformed sockets using proprietary seals approved by the geomembrane manufacturer.

15.8 A coarse sand protection layer, 100 mm thick, is placed over the top of the units that are wrapped in either a geotextile (infiltration system) or a geomembrane with protective geotextile (attenuation system). Backfilling is continued with selected as-dug material with size of pieces less than 75 mm, compacted to 90% maximum dry density. Compaction plant over the top of the system must not exceed 2300 kg per metre width.

15.9 The landscaping over the AquaCell Eco system is completed.

Technical Investigations

16 Tests

Tests were carried out on the system to determine:

- long- and short-term resistance to loading
- volumetric capacity.

17 Investigations

17.1 The manufacturing process was examined, including the method adopted for quality control, and details obtained on the quality and composition of the material used.

17.2 An assessment of the system was made in relation to material properties and design procedures.

17.3 A site visit was made to assess the practicability and ease of installation and connection.

Bibliography

BS EN 752 : 2008 *Drain and sewer systems outside buildings*

ASTM D 638 : 2002 *Test Method for Tensile Properties of Plastics*

ASTM D 751 : 2000 *Standard Test Methods for Coated Fabrics*

ASTM D 792 : 2000 *Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement*

ASTM D 1004 : 1994 *Standard Test Method for Initial Tear Resistance of Plastic Film and Sheeting*

ASTM D 1149 : 1999 *Standard Test Method for Rubber Deterioration — Surface Ozone Cracking in a Chamber*

ASTM D 1203 : 1994 *Standard Test Methods for Volatile Loss From Plastics Using Activated Carbon Methods*
ASTM D 1204 : 2008 *Standard Test Method for Linear Dimensional Changes of Nonrigid Thermoplastic Sheet or Film at Elevated Temperature*
ASTM D 1603 : 2001 *Test Method for Carbon Black in Olefin Plastics*
ASTM D 5397 : 1999 *Standard Test Method for Evaluation of Stress Crack Resistance of Polyolefin Geomembranes Using Notched Constant Tensile Load Test*
ASTM E 96 : 2000 *Standard Test Methods for Water Vapor Transmission of Materials*
FTMS 101C : Method 2065 Puncture test

Conditions of Certification

18 Conditions

18.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page — no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document — it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

18.2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

18.3 This Certificate will remain valid for an unlimited period provided that the product/system and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

18.4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

18.5 In issuing this Certificate, the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- individual installations of the product/system, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product/system is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product/system, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to CE marking.

18.6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.